

Test Report

Report Number: 160303096GZU-005

Applicant Name : Jiangsu Aifuxi New Building Material Stock Co., Ltd **Report Date :** 2016-08-26
Applicant Address : Tunnan Village, Tongli Town, Wujiang District,
Suzhou City, China
Attn : —

Sample Description:

This report pertains only to the sample models listed in the Product Description section of this report. The evaluated production model was submitted via the client's own courier on March 03, 2016. These samples were received in good condition and were evaluated between March 03, 2016 and August 22, 2016 at the Intertek Guangzhou laboratory located at Block E, No.7-2 Guang Dong Software Science Park, Cai Pin Road, Science city, Guangzhou Economic Development Zone, Guangzhou, P. R. China.

Product name: Fiber Cement Board/ Fiber Cement Plank Siding



Trade mark: FC
Model No.: 8mm and 20mm

Conclusion:

1. Content of asbestos
Test method: With reference to NOISH 9002
No asbestos was detected.

Should you have any query on this report, you may contact at lillian.lf.He@intertek.com

Approved by:



Jones Zhong
Project engineer

Prepared by:



Kelming Wang
Technical Team Leader

Terms and Conditions

This report is made solely on the basis of your instructions and/or information and materials supplied by you. It is not intended to be a recommendation for any particular course of action. Intertek does not accept a duty of care or any other responsibility to any person other than the Client in respect of this report and only accepts liability to the Client insofar as is expressly contained in the terms and conditions governing Intertek's provision of services to you. Intertek makes no warranties or representations either express or implied with respect to this report save as provided for in those terms and conditions. We have aimed to conduct the Review on a diligent and careful basis and we do not accept any liability to you for any loss arising out of or in connection with this report, in contract, tort, by statute or otherwise, except in the event of our gross negligence or wilful misconduct.

The conclusions of this test report may no be used as part of the requirements for Intertek product certification. Authority to Mark must be issued for a product to become certified.

TTRF-PERF-02-EN Approved Date: May 5, 2014

Test Report

Report Number: 160303096GZU-005


Test Items, Method and Results:

*When determining the test result, measurement uncertainty has been considered.
If related to subcontract, the remark* for the test items conducted by a subcontractor.*

- 1 Content of asbestos
Requirement: Shall be absent.
With reference to NOISH 9002, qualitative assessment conducted by microscopic examination method.
Microscopical magnification: 400x
Analyte: Actinolite, Amosite, Crocidolite, Tremolite, Anthophyllite, Chrysotile

Test Result:
No asbestos was detected.
Verdict: Pass

Sample Photo

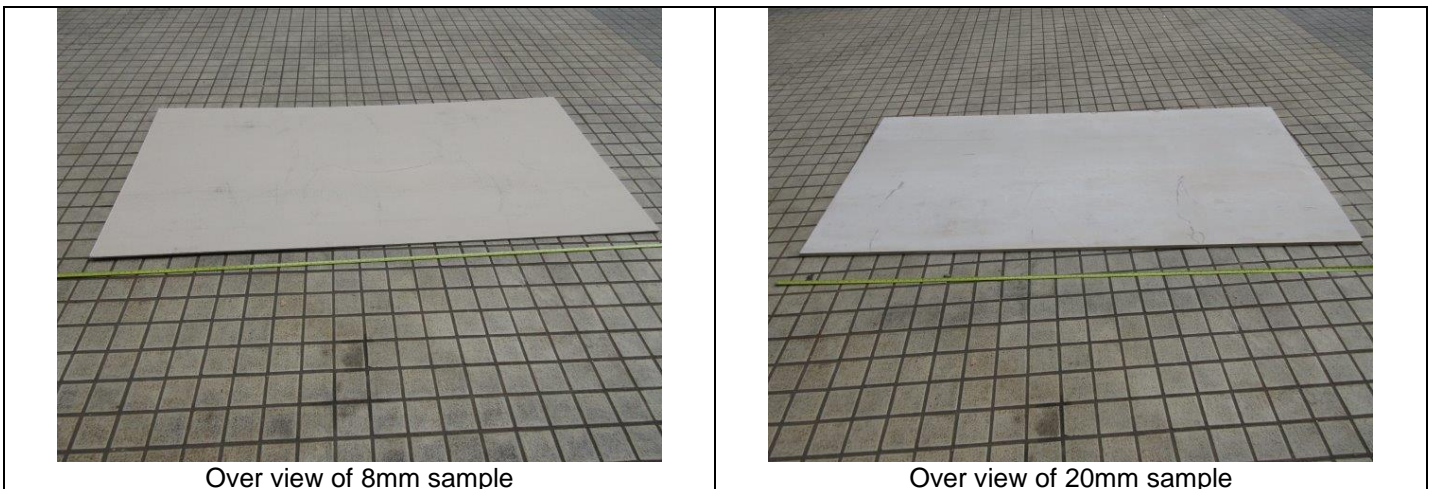

Revision Summary

| DD/MM/YYYY | Project Engineer/ Reviewer | Page # | Project No | Reason for revision |
|------------|-------------------------------|--------|--------------|---------------------|
| 26/08/2016 | Kelming Wang/ Jones Zhong | 2 | 160303096GZU | First issue |

The End of The Report